



Clearcreek Fire District

July 2018


Monthly Report

Highlights

On 7-1-18, the CCFD Honor Guard presented the colors before the Cincinnati Reds game at Great American Ballpark. Thank you to the Cincinnati Reds and all those who came out to support us. We are proud of the CCFD Honor Guard who did a great job representing our community, as well as The Clearcreek Fire District



Station Response Percentages

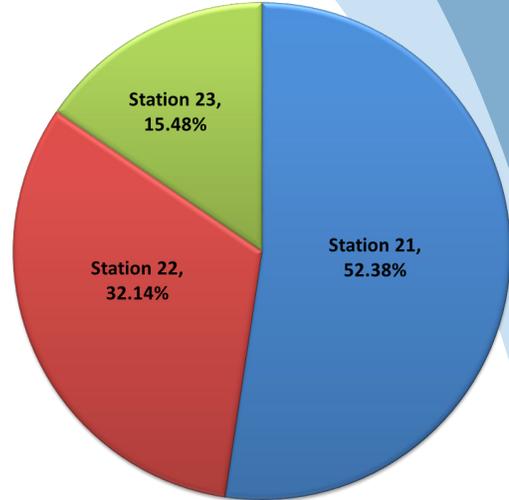

It is not always humans that our firefighters save. On 7/19/18, station 21 received a visit from a hummingbird in need of rescue. The hummingbird had cobwebs and debris stuck to its wings. Luckily, FF/PM Justin Biel was there to help. Justin cleaned the bird's wings, nursed it back to health and released the hummingbird back into the wild. Justin is both proud and sad to see his little one go out and make it on it's own.


Kudos

Kudos to FF/EMT Bunker and FF/EMT Holbrook for completing their probationary employment period and officially becoming a part of the CCFD family.

Kudos to FF/PM Drury for all of his work in updating the fitness equipment for all stations.

Kudos to Captain Prass, Lieutenant Buehler, Lieutenant Null, FF/PM Burkhardt, FF/PM M. Gerspacher, FF/PM Henry, FF/PM LeMaster, FF/PM Lykins, FF/PM Moffitt and FF/EMT Whitney for their work on the New Ambulance Committee. We anticipate delivery of the new medic near the end of August.

Fire/Rescue/EMS By Day of Week

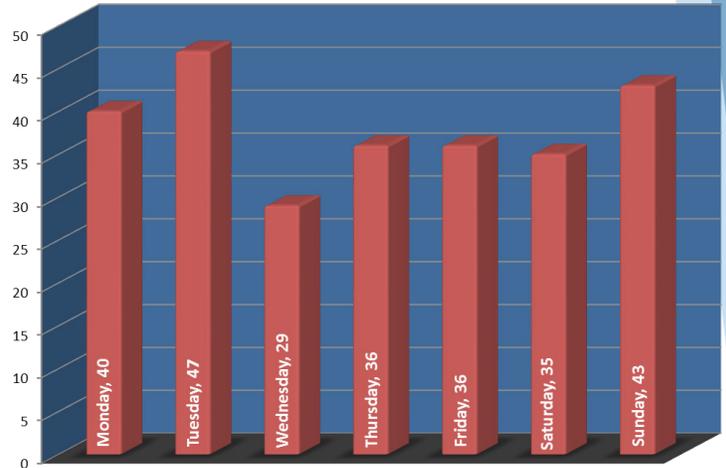

Mutual Aid

FIRE GIVEN = 9

FIRE RECEIVED = 4

EMS GIVEN = 1

EMS RECEIVED = 1


Significant Response Activity

Average response time for July is 5.60 minutes.

Average response time, Year-To-Date, is 5.57 minutes.

**Response times are denoted from the time of dispatch to the time the first unit arrived on the scene, per Warren County Communications.*

Alarms by Service Type

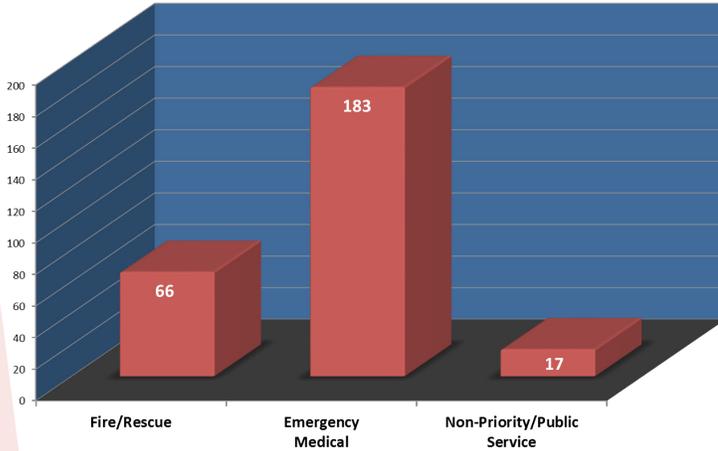

Alarms for July: 266

Alarms Year to Date: 1,755

On 7/22/18 @ 21:04 hours, crews responded to West Central Avenue for a non-breather. Crews initiated ALS procedures but ultimately received a field termination of resuscitation order from medical control.

On 7/26/18 @ 17:48 hours, crews responded to Highpoint Drive for a reported structure fire. Upon arrival, crews found a grill on fire outside of the structure. The fire was contained to the grill and exterior of the house but did not extend into the interior of the structure. The homeowner extinguished the fire prior to crew arrival. The crews secured the propane tank and removed melted items from the area. Washington Township Fire Department provided mutual aid assistance.



Dollars Saved/Loss

TOTAL POTENTIAL PROPERTY LOSS	\$698,500.00
TOTAL PROPERTY LOSS AS A RESULT OF FIRE	\$6,050.00
TOTAL PROPERTY SAVED FROM FIRE DAMAGE	\$692,450.00

On 7/29/18 @ 14:27 hours, Crews responded to East Central Avenue for a reported non-breather. Upon arrival, crews found a patient pulseless and unresponsive. Crews performed ALS procedures and patient regained a pulse. Crews transported the patient to Southview Medical Center.

On 7/31/18 @ 14:05 hours, Crews responded to West Factory Road for a reported non-breather. Upon arrival, crews found a patient pulseless and unresponsive. The patient met non-initiation criteria. Crews contacted the coroner and released the scene to the City of Springboro Police Department.

Fire Prevention Activity

Prevention

On 7/14/18, Station 21 crews participated in a community event (Otterbein 5K Run) at North Park.

On 7/14/18, Station 22 crews attended a block party on Abby Court.

On 7/21/18, Station 22 crews participated in a community event (Bike Parade) at Settlers Walk.

Inspection Activity

On 7/2/18, Lieutenant Carman conducted a site inspection for the City Fireworks at Springboro High School.

On 7/2/18, Lieutenant Carman conducted a site inspection for the Fireworks at Austin Center.

Plans Review

Lieutenant Carman reviewed the following plans during July 2018:

1. Fire Sprinkler Plan, The Sanctuary on Clearcreek Franklin Road.
2. General Site Plan, Hardy Diagnostics, 429 South Pioneer Boulevard.

Training

EMS Training

Crews completed competency based training on Trauma Patient Assessment.

Crews completed protocol review of Sepsis.

Prevention Training

Fire Inspectors completed the second of six 2018 Fire Code updates.

Special Training

Senior members completed a professional development training on Blue Card Incident Command.

Fire & Rescue Training



Crews completed competency based training with hand-line deployments.

Administrative Activity

On 7/17/18, Chief Agenbroad and Assistant Chief Simpson attended an Observe, Orient, Decide, & Act training presentation. This training was provided/hosted by Warren County Emergency Services.

On 7/17/18, Chief Agenbroad and Assistant Chief Simpson attended a Community Overdose/Addiction Forum. This community forum was hosted by the Warren County Board of Commissioners.

Chief Agenbroad attended the Annual Ohio Fire Chiefs Association Conference and Symposium from 7/12/18 through 7/16/18.

On 7/9/18, 7/10/18, 7/16/18, and 7/31/18, Assistant Chief Simpson continued work with the Project Tri-Tech Core project implementation team on developing the initial standard operating environment for the Mobile CAD computers.

Assistant Chief Simpson, Captain Urban, and Lieutenant Buehler attended an EMS Chief's presentation and orientation tour of the new Kettering Health Network Emergency Middletown facility on 7/16/18 and 7/26/18, respectively. Scheduled to open on 8/8/18, this new emergency facility provides another nearby transport option for our EMS units.

Fire Administration participated along with Clearcreek Township Administration in several conference calls with ADP Payroll Services and VCS software in preparation to improve payroll processes through a new export system. Meetings were held on 7/3/18, 7/17/18, 7/24/18, and 7/31/18.

Chief Agenbroad, Assistant Chief Simpson, and Captain Scott, along with members of the Command Staff, continued work on the new Lexipol policy manual review and implementation process.



- If you are putting in a new pool, hot tub, or spa be sure the wiring is performed by an electrician experienced in the special safety requirements for these types of installations.
- Outdoor receptacles must have covers that keep them dry even when appliances are plugged into them.
- Ground-fault circuit interrupters (GFCIs) are special devices designed to protect against electric shock and electrocution. They are required for most pool, spa or hot tub equipment. They may be in the form of an outlet or a circuit breaker. Test the GFCIs monthly according to the manufacturer's instructions.
- Electrical appliances, equipment, and cords should be kept at least 6 feet away from the water. When possible, use battery operated appliances and equipment, such as televisions, radios, and stereos.
- Avoid handling electrical devices when you are wet.
- Make sure that any overhead lines maintain the proper distance over a pool and other structures, such as a diving board. If unsure, contact a qualified electrician or your local utility company to make sure power lines are a safe distance away.
- Do not swim during a thunderstorm.
- Have a qualified electrician periodically inspect and—where necessary—replace or upgrade the electrical devices or equipment that keep your pool, spa, or hot tub electrically safe.
- Have a qualified electrician show you how to turn off all power in case of an emergency.

KNOW THE RISKS!

Electrocution is death by an electrical shock. Be aware when skin is wet or when surrounding surfaces, such as the grass or pool deck, are wet. Wet skin or wet surfaces can greatly increase the chance of electrocution when electricity is present.

There are several signs of electrical shock. Swimmers may feel a tingling sensation. They may experience muscle cramps. They may not be able to move. They may feel as if something is holding them in place.

If you think someone in the water is being shocked, turn off all power, but do not attempt to go in the water. Use a fiberglass or other kind of rescue hook that doesn't conduct electricity to help the swimmer. Have someone call 9-1-1.

If you think you are being shocked while in the water move away from the source of the shock. Get out of the water.

FACT

The U.S. Consumer Product Safety Commission has reports of 14 deaths related to electrocutions in swimming pools from 2003 to 2014. Hot tubs and spas may present the same hazard as swimming pools.



NATIONAL FIRE PROTECTION ASSOCIATION
The leading information and knowledge resource on fire, electrical and related hazards

www.nfpa.org/education ©NFPA 2017



Station 21

925 South Main Street
Springboro, OH 45066

Station 22

346 East Lytle Five Points Road
Springboro, OH 45066

Station 23

3809 North State Route 48
Lebanon, OH 45036

